


WARREN ELECTRIC HEATER MODEL W3P SERIES	INSTALLATION INSTRUCTIONS Date: 06-01-09	NORDYNE PACKAGE UNITS Q3RA / Q3RC / Q3RD P3RA / P3RC / P3RD / GP3RD / GP5RD Q4SA / Q4SC / Q4SD P4SA / P4SC / P4SD
--	--	--

GENERAL

This electric heater series is engineered, designed, and approved to be installed in the (24 through 60) single package units. Before proceeding, check the heater label for correct voltage and KW requirements.

Installation and servicing of this equipment should only be performed by trained and qualified personnel. Before proceeding with the heater installation, inspect thoroughly for shipping damage. Notify the shipper immediately if any damage is found. Check all porcelain insulators for breakage and inspect heater element wire to see that none have been deformed. Clean all dirt, dust and moisture from equipment. Check for proper clearances of live parts, between phases, and to ground. Make sure that all required barriers are in place. Check conductors run in multiple to insure that they are properly wired. Refer to installation instructions for complete unit installation details.

WARNING 

Before performing service or maintenance operations on system, turn off all main power switches. There may be more than one disconnect. Turn off accessory heater power switch if applicable. Electrical shock can cause personal injury. **TAG DISCONNECT SWITCH(ES) WITH A SUITABLE WARNING LABEL.**

HEATER INSTALLATION

1. Refer to the base unit installation instructions as required
Affix Warren Installer label to the equipment access panel.
2. Remove blower section access panel of air handler.
3. Remove cover plate in front of blower assembly.
4. Slide heater assembly into blower section through the access opening. Secure heater into place with screws from cover plate.
5. Remove the conduit knockout in unit cabinet for electrical connections. Install the appropriate size conduit connector.

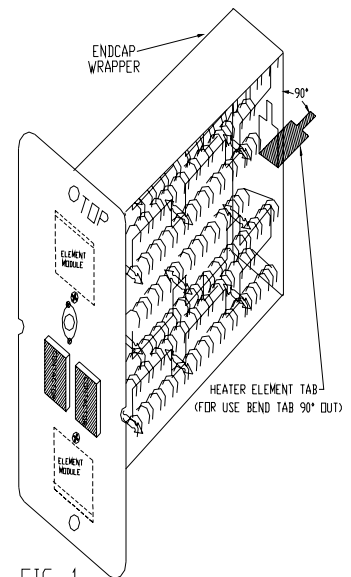


FIG. 1

HEATERS WITH CIRCUIT BREAKERS:

***NOTE:** Circuit breakers supplied with the H3HK electric heater kits are for short-circuit protection of the internal wiring and to serve as a unit disconnect. Circuit breakers supplied with the H3HK electric heater kits do not provide over-current protection of the supply wiring. Over-current protection of the supply wiring must be provided at the distribution panel and sized as shown on the unit data label and per the NEC and applicable local codes. In some cases the over-current protection specified in on the unit data label is less than the 60 amp rating of the circuit breakers used in the H3HK electric heater kits. This is because the function of the over-current protection required at the distribution panel (field supplied) and the function of the circuit breakers in the H3HK electric heater kit is different.

**NOTE: CIRCUIT BREAKERS MUST BE COVERED. COVER PLATE PROVIDED)
CIRCUIT BREAKERS MUST BE SEALED TIGHT TO AVOID ELECTRICAL SHOCK.**

1. Circuit breakers are rated for heater only. Unit circuit breaker space is provided.
2. Remove circuit breaker knockout(s) in unit access panel as required. Cut out insulation in opening. Mount circuit breaker with two screws using mounting holes provided.

WARNING !

Before performing service or maintenance operations on system, turn off all main power switches. There may be more than one disconnect. Turn off accessory heater power switch if applicable. Electrical shock can cause personal injury. **TAG DISCONNECT SWITCH(ES) WITH A SUITABLE WARNING LABEL.**

ELECTRICAL CONNECTIONS

1. All electrical connections, wire sizes and type and conduit sizes shall meet the National Electric Code, State and Local Codes. Main power supply, minimum wire sizes, circuits, fusing, etc. is shown on schematic wiring diagrams.

NOTE: Use copper wire only.

2. Refer to base unit instructions for recommended wiring procedures.
3. Connect heater plug to corresponding plug in the air handler.
4. Separate all wires from incoming power leads.
5. Be sure that all electrical terminal connections, clamps, screws, etc. are tight before proceeding.
6. Check wiring diagram supplied with heater for specific connections and information.
7. Check operation as described in start-up section.

START-UP AND CHECK-OUT

CAUTION: Before proceeding, verify that all wiring is correct per factory approved schematic. Notify factory immediately of any discrepancies.

1. Refer to base unit installation instructions as required.
2. Check for loose terminal connections.
3. Check that all fuse and circuit breaker short circuit interrupting ratings are adequate.
4. Turn on unit and heater power.
5. Set thermostat to call for heat.
6. Check operation of heater.
7. Check that air flow across heater is at or above minimum recommended fan speed.
8. Any modification or repairs to this equipment without written permission from the factory will be done at the installer's own risk and expense.

SERVICE

Fuses/Circuit Breaker - Malfunction will interrupt power to unit. *Check for cause of failure, correct, and replace fuses or reset circuit breaker.*

Limit Switch/Fusible Link - Malfunction prevents heating element(s) from being energized. *Replace switch if malfunction occurs.*

Sequencers- *Malfunction will not allow heater to come on or shut off. Replace faulty sequencers. Do not attempt to replace coil or dress contacts.*

ELECTRIC HEATER PACKAGE CONTENTS

1. Heater assembly
2. Installation Instructions
3. Installer label
4. Schematic