
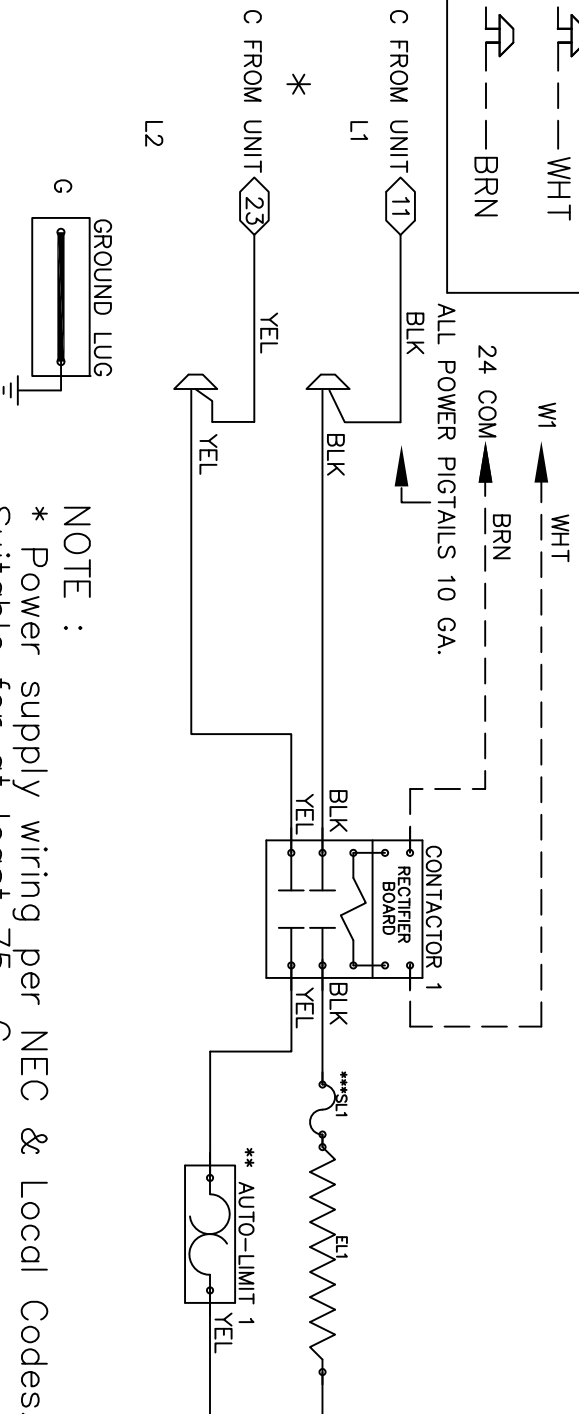


# WGS-0381/0502

USE PLUG ADAPTOR ON: 50CE/50CR/50DT/  
50DU/50XL/50XT/604C/607B/607D/704C/  
707B/704C/707B/707D.

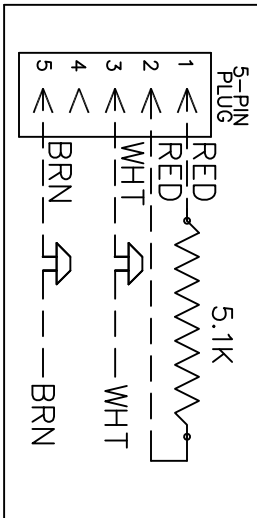

**NOTE :**

- \* Power supply wiring per NEC & Local Codes. Suitable for at least 75 C Use copper conductor wiring only.
  - \*\* Replace Auto-Reset with Therm-O-Disc type 60TX11-L165
  - \*\*\* Replace Service-Loop With SL075B
- CAUTION-RELAYS UTILIZE 22VDC COILS WITH AC TO DC RECTIFIERS. DO NOT USE RELAY WITHOUT RECTIFIER REPLACE WITH FACTORY AUTHORIZED PARTS ONLY.
- 24VAC, Class 2 power source must not exceed 26.4VAC under any primary input voltage condition per U.L./NEC.

Model \_\_\_\_\_  
 Serial # \_\_\_\_\_  
 Tag - \_\_\_\_\_  
 Kilowatts \_\_\_\_\_  
 Volts-Ph-Hz \_\_\_\_\_  
 Control Volts \_\_\_\_\_  
 Steps \_\_\_\_\_  
 Heater Amps \_\_\_\_\_  
 Heater Fuses \_\_\_\_\_

WGS-0381/0502
3.8/5.0
208/240/1/60
24.0
1
18.1/20.8
N/A

Control Wiring -----  
 Power Wiring \_\_\_\_\_  
 Field Wiring \_\_\_\_\_

WGS0502

Rev. by : M. REEVES  
 Date : 10/07/14

WARREN TECHNOLOGY