


WGS - 0753 / 1004

USE PLUG ADAPTOR ON: 50CE/50CR/50DT/
50DU/50XL/50XT/604C/607B/607D/704C/
707B/704C/707B/707D.

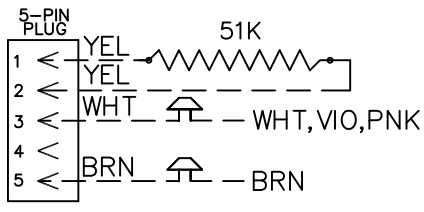


24 COM ← BRN
W1 ← WHT
W2 ← VIO
W3 ← PNK

ALL POWER PIGTAILS 10 GA.

C FROM UNIT 11
L1 ← BLK

C FROM UNIT 13
* L2 ← YEL

IFR OR TDR:1
FROM UNIT 2
L3 ← BLU



Model	WGS-0753/1004
Serial #	_____
Tag -	_____
Kilowatts	7.5/10.0
Volts-Ph-Hz	208/240/3/∧/60
Control Volts	24.0
Steps	3
Heater Amps	20.8/24.1
Heater Fuses	N/A
Control Wiring	-----
Power Wiring	_____
Field Wiring	_____

NOTE :

* Power supply wiring per NEC & Local Codes.
Suitable for at least 75° C

Use copper conductor wiring only.
Field wire, NEC Class I

** Replace Auto-Reset with Therm-O-Disc
type 60TX11-L165

*** Replace Auto-Reset with Therm-O-Disc
type 64TX11-2PL-L165

**** Replace "Service Loop" with SL075B

CAUTION-RELAYS UTILIZE 22VDC COILS WITH AC TO DC
RECTIFIERS. DO NOT USE RELAY WITHOUT RECTIFIER
REPLACE WITH FACTORY AUTHORIZED PARTS ONLY.

-24VAC, Class 2 power source must not exceed 26.4VAC
under any primary input voltage condition per U.L./NEC.

WGS1004

Rev. by : M. REEVES
Date : 10/07/14

WARREN TECHNOLOGY