


WUHI — 0752B

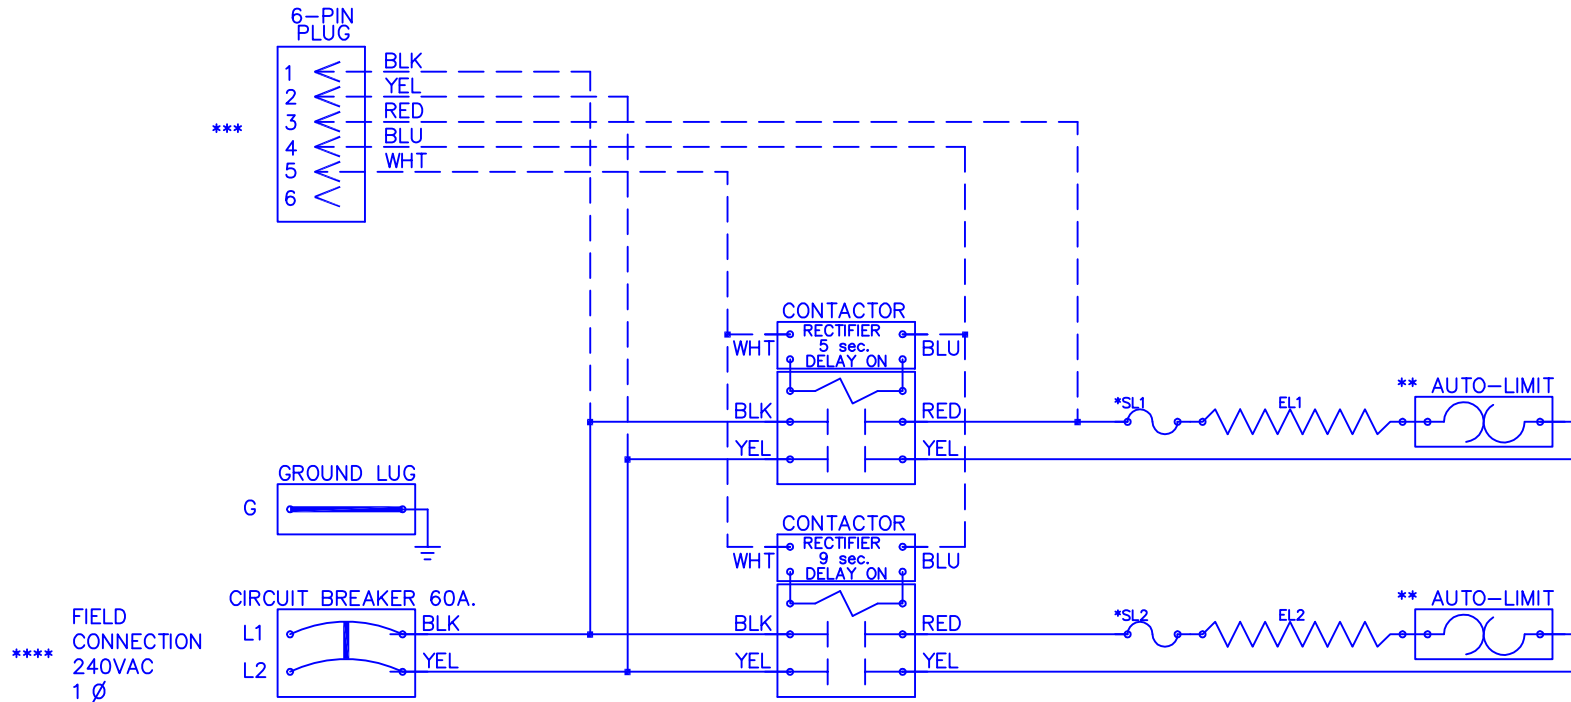

FIELD
CONNECTION
240VAC
1 ∅

NOTE :

CAUTION – Contactors utilize 22–28VDC coils with AC to DC rectifiers. Do not use contactor without rectifier. Replace with factory authorized parts only.
– Contactor must always utilize AC–DC Rectifier with Time Delay as shown.

* Replace "Service Loop" with SL-075B

** Replace Auto-Reset with Therm-O-Disc type 64TX11-2PL165

*** 24VAC, Class 2 power source must not exceed 26.4VAC under any primary input voltage condition per UL/NEC.

**** Power supply wiring per NEC & Local Codes. Suitable for at least 75°C.

Use copper conductor wiring only.

Model	<u>WUH-0752B</u>
Serial #	<u> </u>
Tag -	<u> </u>
Kilowatts	<u>7.2</u>
Volts-Ph-Hz	<u>240/1/60</u>
Control Volts	<u>24.0</u>
Steps	<u>1</u>
Heater Amps	<u>30.0</u>
Circuit Breakers	<u>See C.B. above</u>

Control Wiring - - - - -
Power Wiring
Field Wiring

WUH0752B

Rev. by : M. REEVES
Date : 02/27/15

WARREN TECHNOLOGY