


WZHI — 0272SX

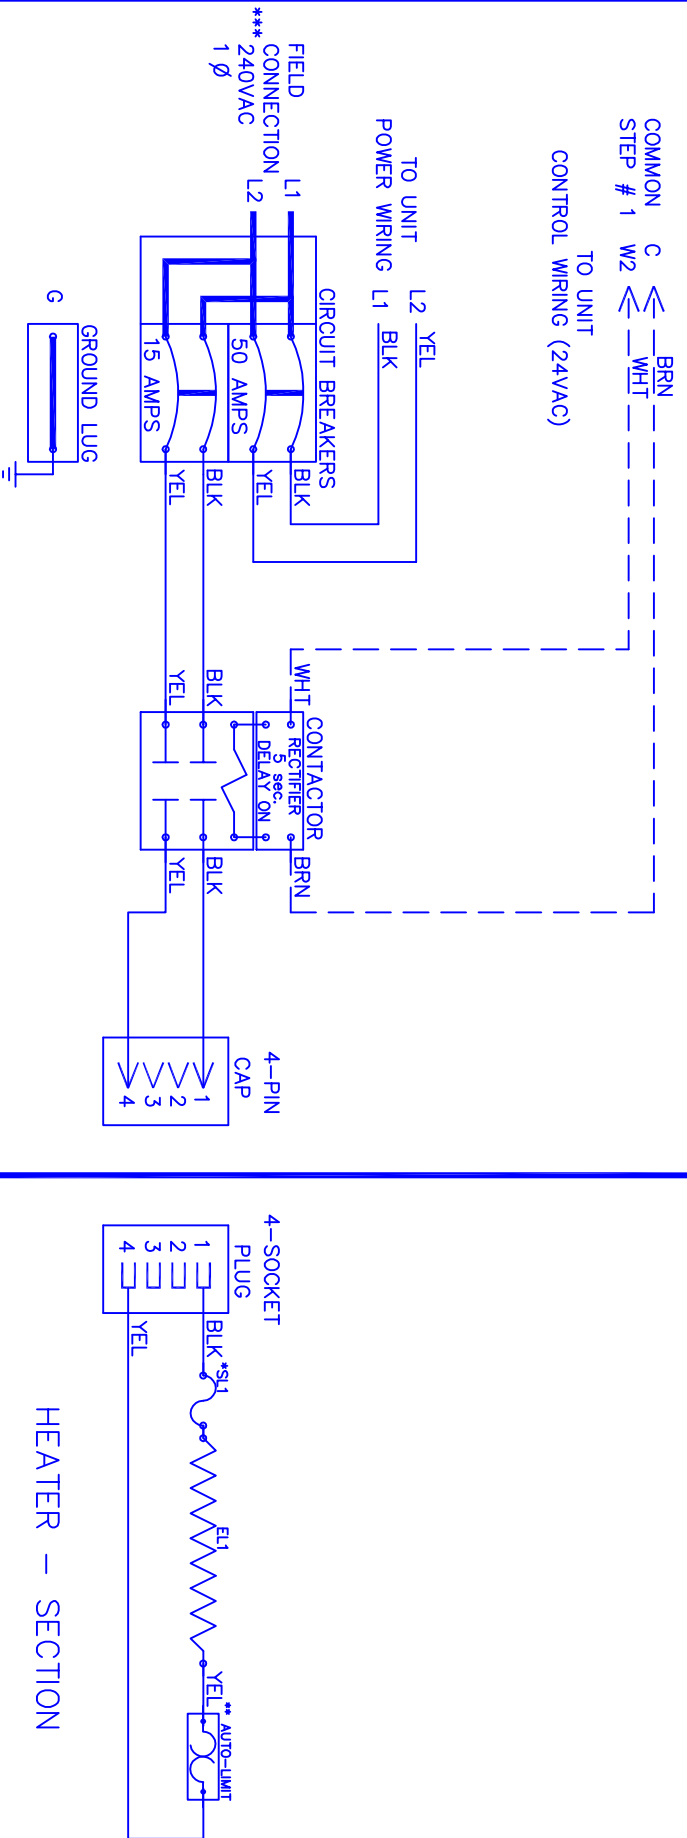

Model WZH-0272SX
 Serial # _____
 Tag - _____
 Kilowatts 2.70
 Volts-Ph-Hz 240/1/60
 Control Volts 24.0
 Steps 1
 Heater Amps 11.25
 Circuit Breakers 15/50

NOTE :

- * Replace "Service Loop" with SL-075B
- ** Replace Auto-Reset with Therm-O-Disc type 60TX11-L165.
- *** Power supply wiring per NEC & Local Codes. Suitable for at least 75°C.

Use copper conductor wiring only.
 Relays utilize 22VDC coils with AC to DC rectifiers. Do not use relay without rectifier.
 Replace with factory authorized parts only.
 24VAC, Class 2 power source must not exceed 26.4VAC under any primary input voltage condition per UL/NEC.

Control Wiring _____
 Power Wiring _____
 Field Wiring _____

Rev. by : M. REEVES
 Date : 02/27/15

WARREN TECHNOLOGY

WZH0272XS