


WZIH — 0502SX

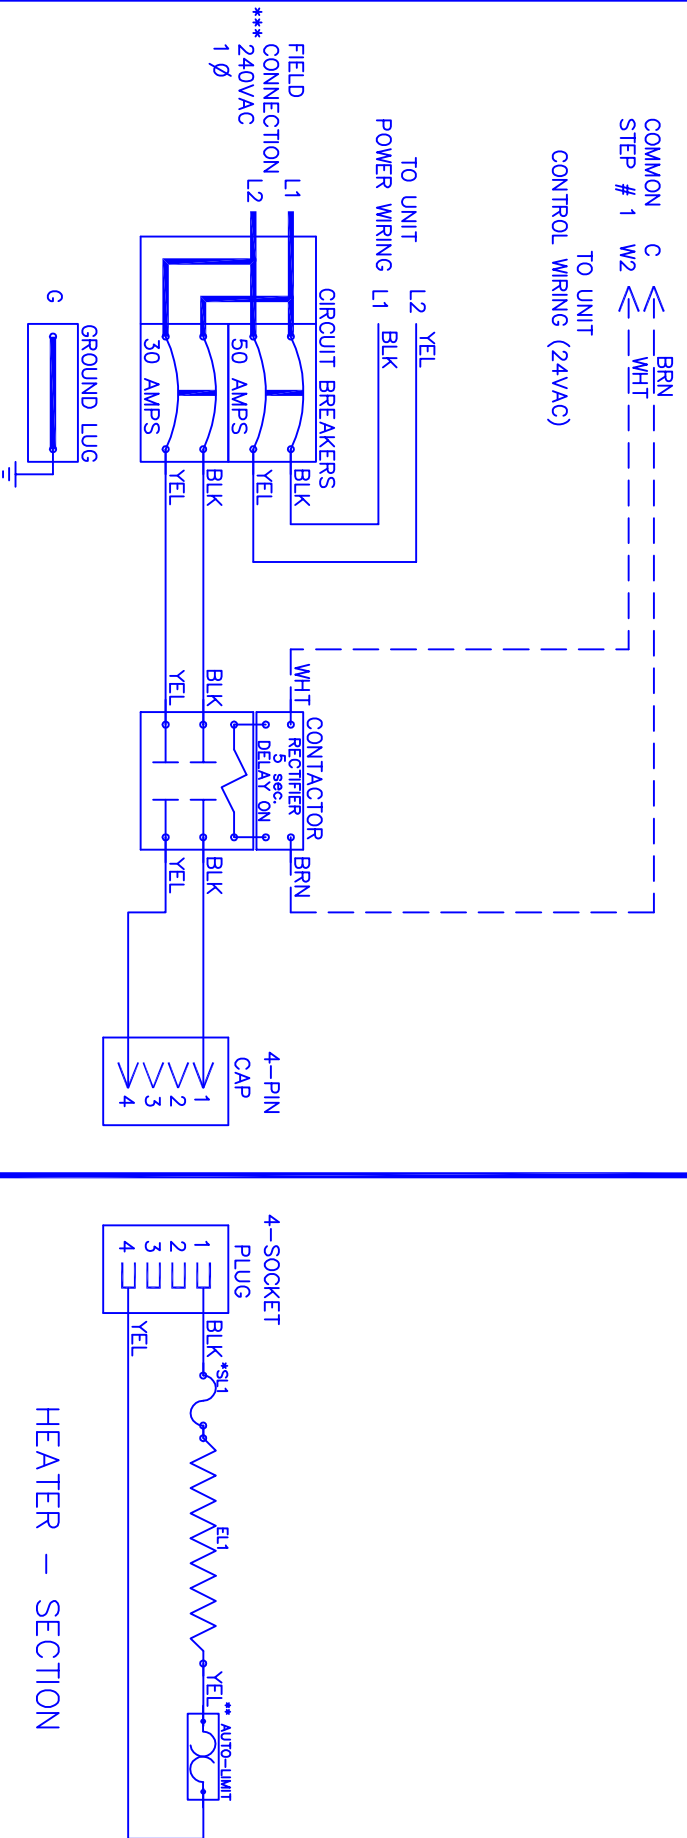

NOTE :

- * Replace "Service Loop" with SL-075B
- ** Replace Auto-Reset with Therm-O-Disc type 60TX11-L165.
- *** Power supply wiring per NEC & Local Codes. Suitable for at least 75°C.
- Use copper conductor wiring only.
- Relays utilize 22VDC coils with AC to DC rectifiers. Do not use relay without rectifier.
- Replace with factory authorized parts only.
- 24VAC, Class 2 power source must not exceed 26.4VAC under any primary input voltage condition per UL/NEC.

Model	WZH-0502SX
Serial #	_____
Tag -	_____
Kilowatts	5.00
Volts-Ph-Hz	240/1/60
Control Volts	24.0
Steps	1
Heater Amps	20.83
Circuit Breakers	30/50

WZH0502XS

Rev. by : M. REEVES
Date : 02/27/15

WARREN TECHNOLOGY

Control Wiring _____
 Power Wiring _____
 Field Wiring _____