
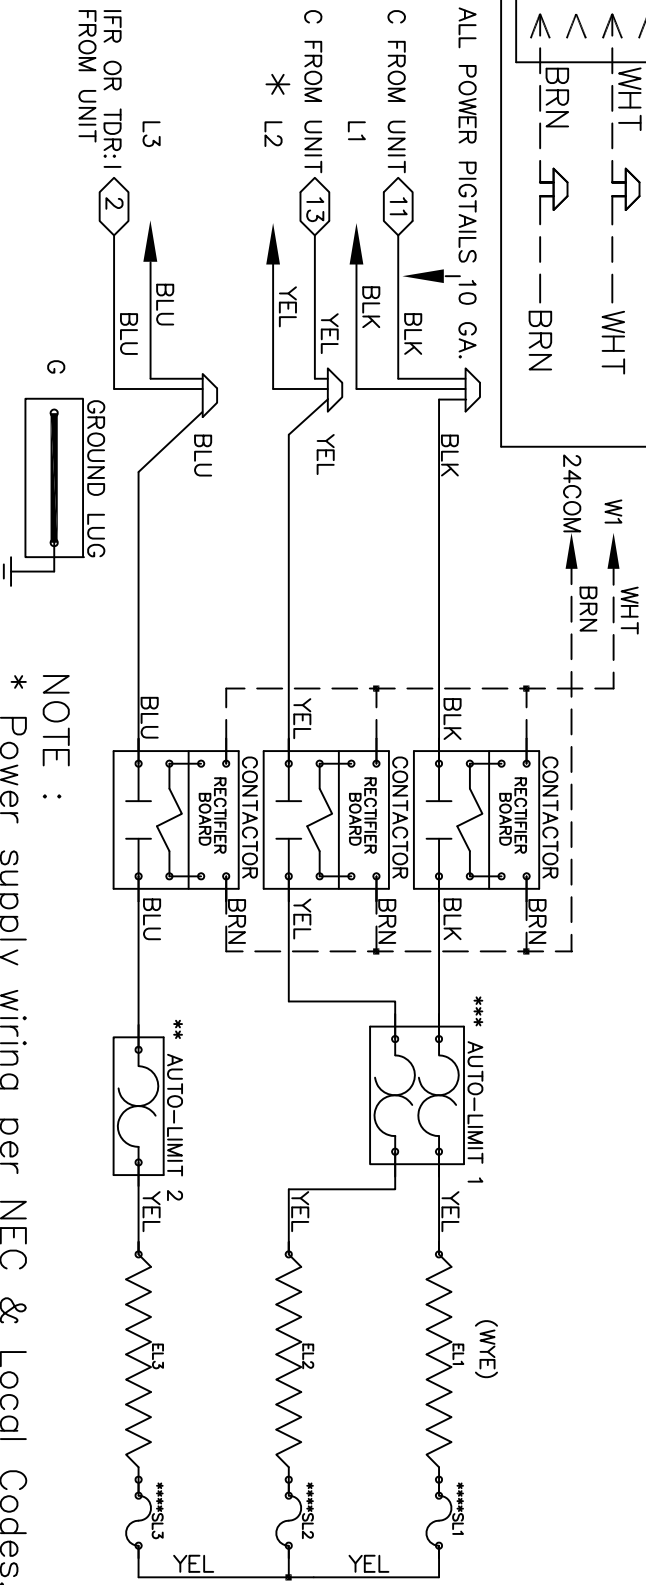


# WGS-0383 / 0504

USE PLUG ADAPTOR ON: 50CE/50CR/50DT/  
50DU/50XL/50XT/604C/607B/607D/704C/  
707B/704C/707B/707D.

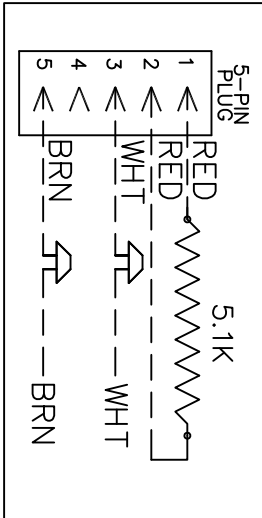

**NOTE :**

- \* Power supply wiring per NEC & Local Codes. Suitable for at least 75° C Use copper conductor wiring only.
  - \*\* Replace Auto-Reset with Therm-O-Disc Field wire, NEC Class I
  - \*\* Replace Auto-Reset with Therm-O-Disc type 60TX11-L165
  - \*\*\* Replace Auto-Reset with Therm-O-Disc type 64TX11-2PL-L165
  - \*\*\*\* Replace "Service Loop" with SL075B
- CAUTION-RELAYS UTILIZE 22VDC COILS WITH AC TO DC RECTIFIERS. DO NOT USE RELAY WITHOUT RECTIFIER REPLACE WITH FACTORY AUTHORIZED PARTS ONLY.
- 24VAC, Class 2 power source must not exceed 26.4VAC under any primary input voltage condition per U.L./NEC.

Model \_\_\_\_\_ WGS-0383/0504  
 Serial # \_\_\_\_\_  
 Tag - \_\_\_\_\_  
 Kilowatts 3.8/5.0  
 Volts-Ph-Hz 208/240/3/60  
 Control Volts 24.0  
 Steps 1  
 Heater Amps 10.4/12.0  
 Heater Fuses N/A  
 Control Wiring \_\_\_\_\_  
 Power Wiring \_\_\_\_\_  
 Field Wiring \_\_\_\_\_