


WKS0221B / 0302B

ELECTRIC HEAT ASSEMBLY

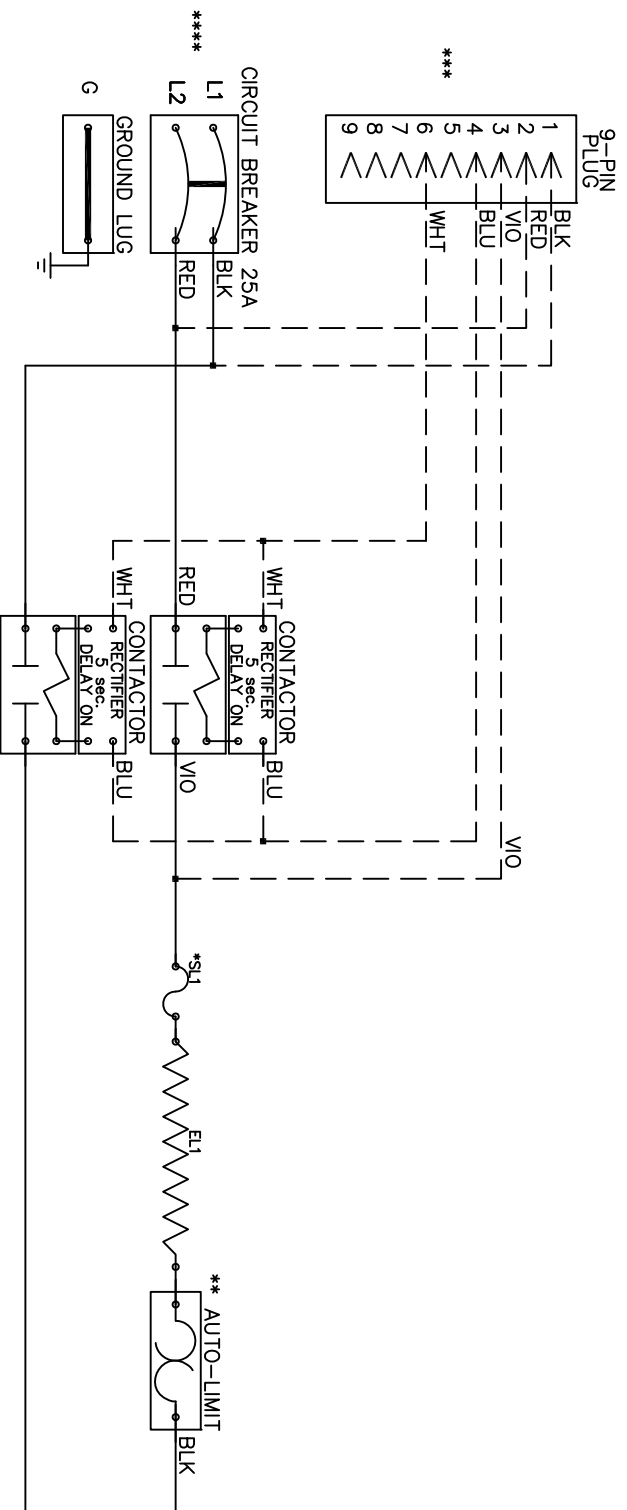

NOTE :
CAUTION – Contactors utilize 22–28VDC coils with AC to DC rectifiers. Do not use contactor without rectifier. Replace with factory authorized parts only.

– Contactor must always utilize AC–DC Rectifier with Time Delay as shown.

*Replace service loops with SL–075B

** Replace Auto–Reset with Therm–0–Disc type 60TX11–L165

*** 24VAC, Class 2 power source must not exceed 26.4VAC under any primary input voltage condition per UL/NEC.

**** Power supply wiring per NEC & Local Codes. Suitable for at least 75°C. Use copper conductor wiring only.

Model	_____	WKS–0221B/0302B
Serial #	_____	
Tag –	_____	
Kilowatts	_____	2.2/3.0
Volts–Ph–Hz	_____	208/240/1/60
Control Volts	_____	24.0
Steps	_____	1
Heater Amps	_____	10.8/12.5
Circuit Breakers	_____	See CB Above

Control Wiring _____
 Power Wiring _____
 Field Wiring _____