WKS0361B/0502B

ELECTRIC HEAT ASSEMBLY

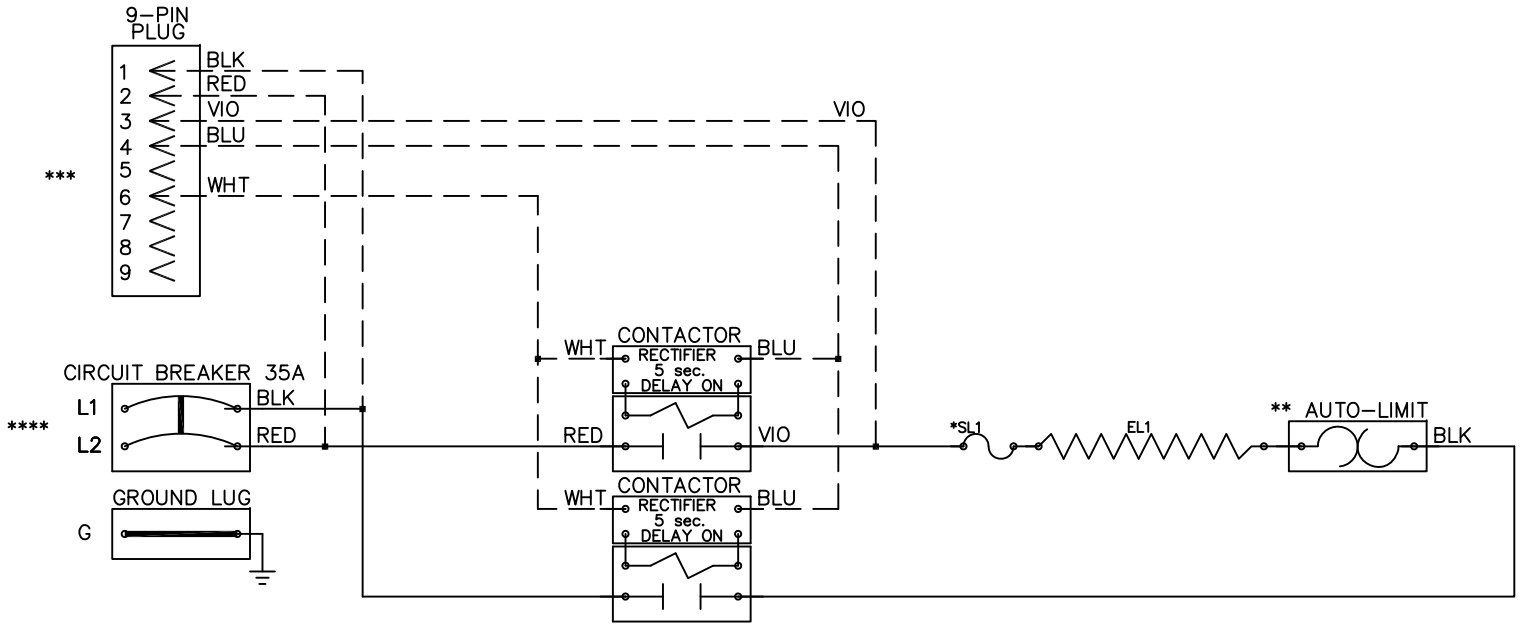

NOTE :
CAUTION – Contactors utilize 22–28VDC coils with AC to DC rectifiers. Do not use contactor without rectifier. Replace with factory authorized parts only.
–Contactor must always utilize AC–DC Rectifier with Time Delay as shown.
*Replace service loops with SL–075B
** Replace Auto–Reset with Therm–O–Disc type 60TX11–L165
*** 24VAC, Class 2 power source must not exceed 26.4VAC under any primary input voltage condition per UL/NEC.
**** Power supply wiring per NEC & Local Codes. Suitable for at least 75°C.
Use copper conductor wiring only.

Model	WKS–0361B/0502B
Serial #	
Tag –	
Kilowatts	3.6/4.8
Volts–Ph–Hz	208/240/1/60
Control Volts	24.0
Steps	1
Heater Amps	17.3/20.0
Circuit Breakers	See CB Above

Control Wiring – – – – – – – – –
Power Wiring ————————
Field Wiring ————————

WKS0502B

Rev. by : M. REEVES
Date : 02/27/15

WARREN TECHNOLOGY