


WKS-0363/0504

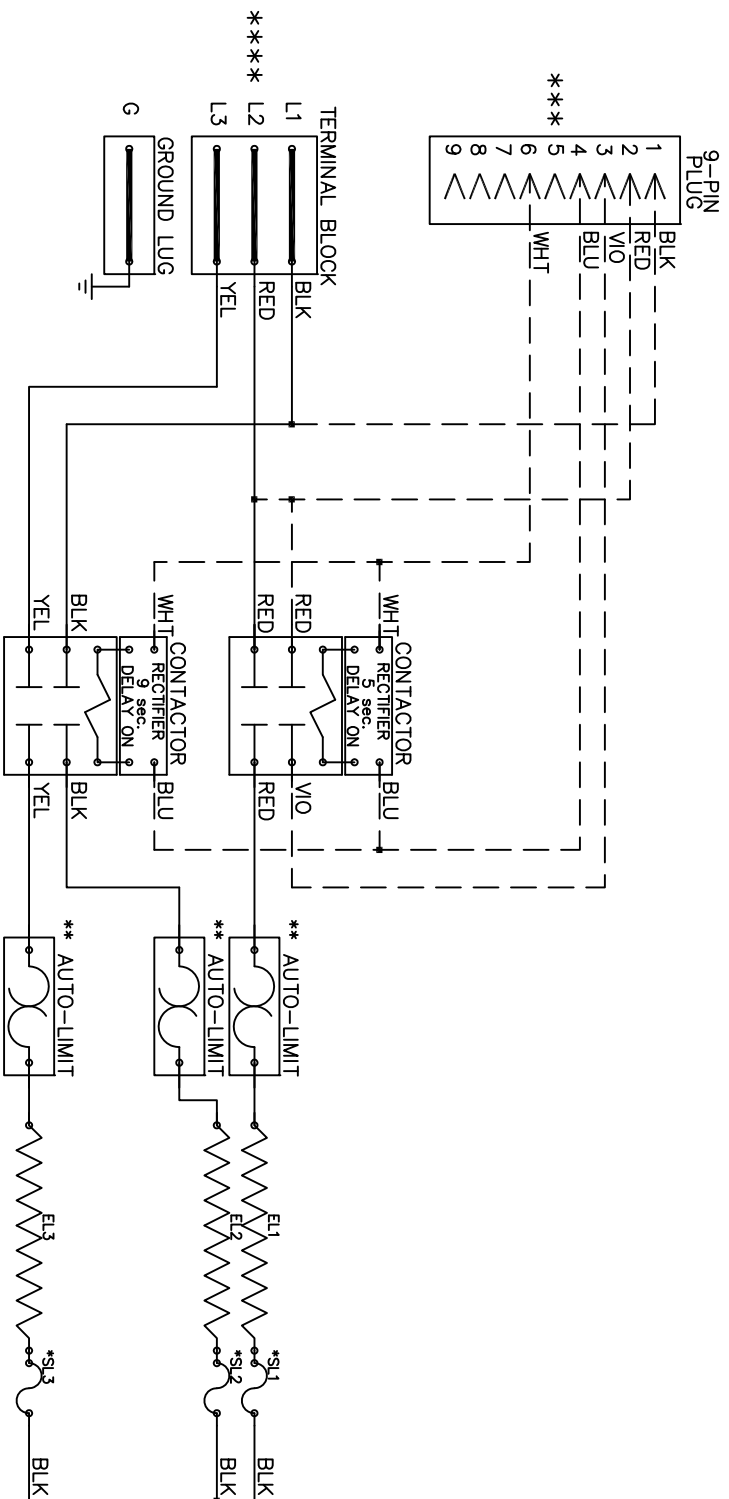

Model WKS-0363/0504
 Serial # _____
 Tag - _____
 Kilowatts 3.6/4.8
 Volts-Ph-Hz 208/240/3Y/60
 Control Volts 24.0
 Steps 1
 Heater Amps 10.0/11.5
 Circuit Breakers N/A

NOTE :
CAUTION - Contactors utilize 22-28VDC coils with AC to DC rectifiers. Do not use contactor without rectifier. Replace with factory authorized parts only.
 -Contactor must always utilize AC-DC Rectifier with Time Delay as shown.
 * Replace service loops with SL-075B
 ** Replace Auto-Reset with Therm-O-Disc type 60TX11-L165
 *** 24VAC, Class 2 power source must not exceed 26.4VAC under any primary input voltage condition per UL/NEC.
 **** Power supply wiring per NEC & Local Codes. Suitable for at least 75°C.
 Use copper conductor wiring only.

Control Wiring _____
 Power Wiring _____
 Field Wiring _____

Rev. by : M. REEVES
 Date : 02/27/15

WARREN TECHNOLOGY

WKS0504