


WKS-0601B / 0802B

ELECTRIC HEAT ASSEMBLY

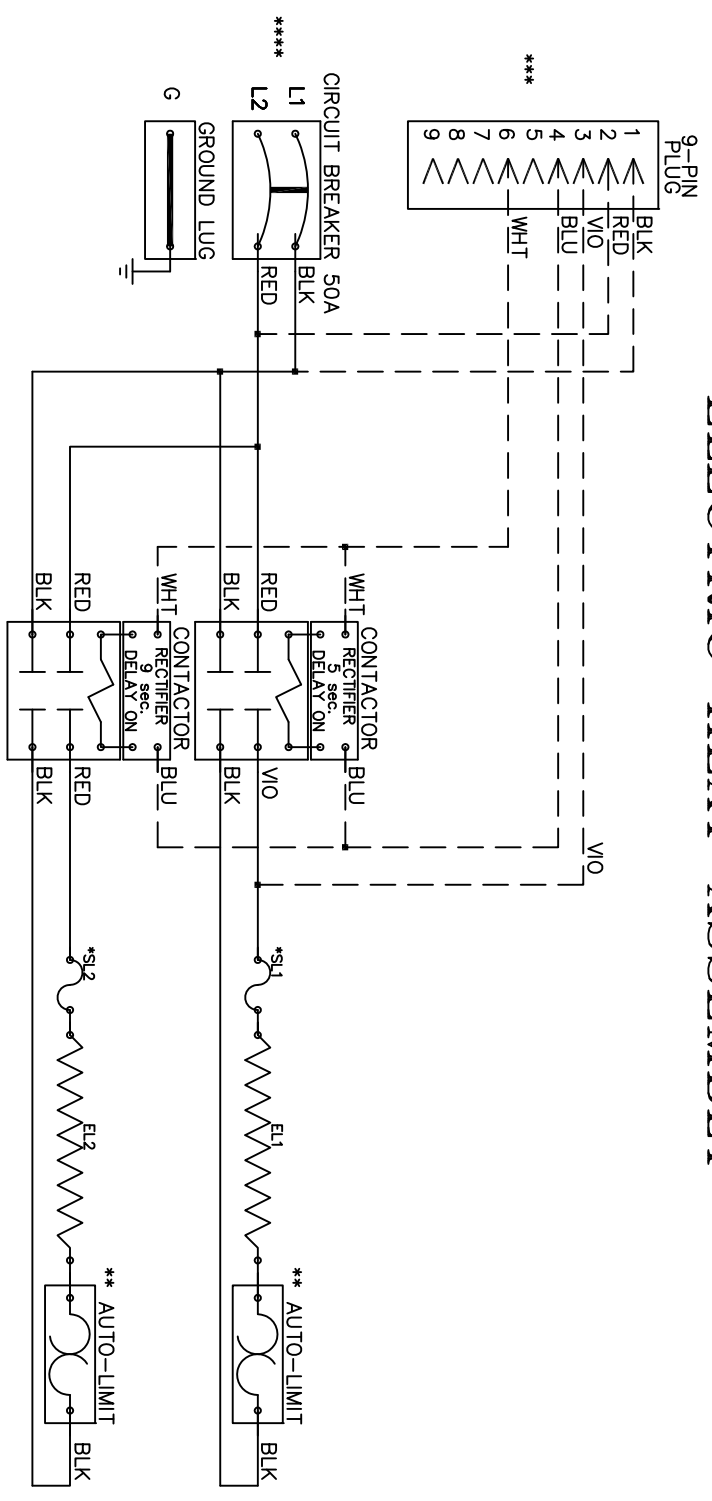

Model	WKS-0601B/0802B
Serial #	
Tag -	
Kilowatts	6.0 / 8.0
Volts-Ph-Hz	208/240/1/60
Control Volts	24.0
Steps	1
Heater Amps	28.8 / 33.3
Circuit Breakers	See CB Above

NOTE :
CAUTION - Contactors utilize 22-28VDC coils with AC to DC rectifiers. Do not use contactor without rectifier. Replace with factory authorized parts only.
 -Contactor must always utilize AC-DC Rectifier with Time Delay as shown.
 *Replace service loops with SL-075B
 ** Replace Auto-Reset with Therm-O-Disc type 60TX11-L165
 *** 24VAC, Class 2 power source must not exceed 26.4VAC under any primary input voltage condition per UL/NEC.
 **** Power supply wiring per NEC & Local Codes. Suitable for at least 75°C.
 Use copper conductor wiring only.

Control Wiring -----
 Power Wiring -----
 Field Wiring -----

WKS0802B