


**IMPORTANT: WIRE CONNECTION TO TERMINAL BLOCK ON AIRHANDLER MUST BE CONNECTED AS SHOWN.**

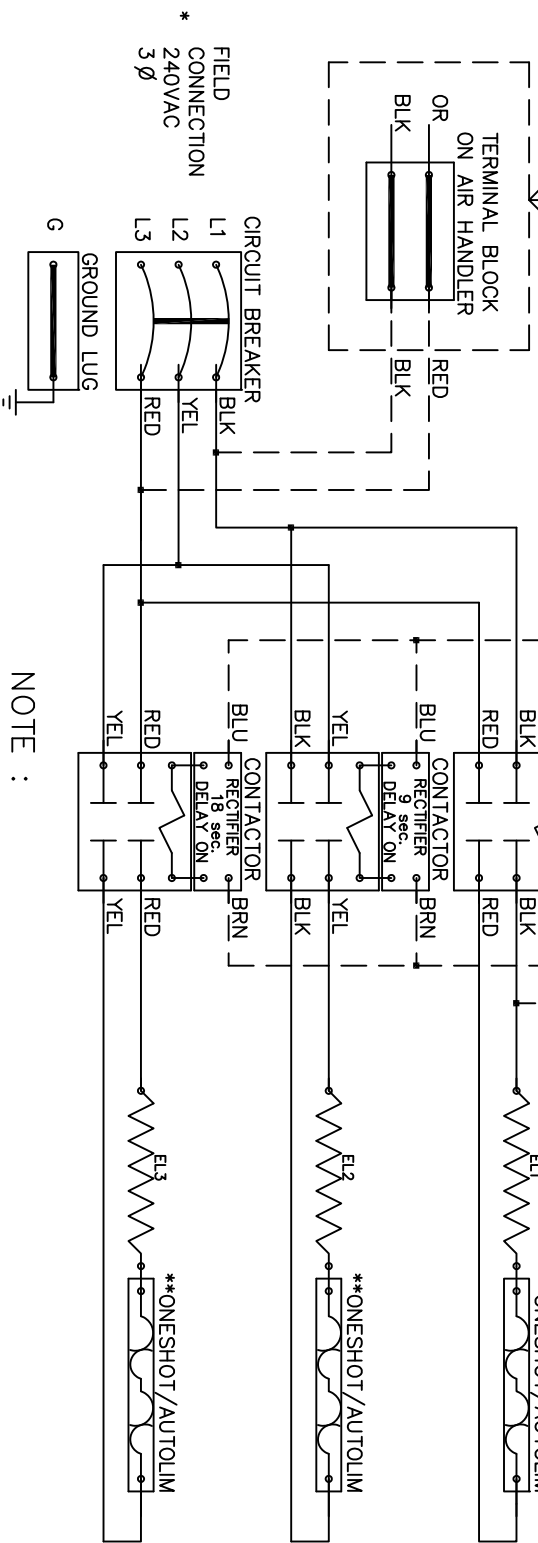

**NOTE :**

- \* Power supply wiring per NEC & Local Codes. Suitable for at least 75°C. Use copper conductor wiring only.
  - \*\* Replace One Shot/Auto-Reset with Therm-O-Disc type L150F-333F
  - \*\*\* Relays utilize 22-28VDC coils with AC to DC rectifiers. Do not use relay without rectifier.
- 24VAC, Class 2 power source must not exceed 26.4VAC under any primary input voltage condition per UL/NEC.

Model \_\_\_\_\_ WRX-1004B

Serial # \_\_\_\_\_

Tag - \_\_\_\_\_

Kilowatts \_\_\_\_\_ 9.6

Volts-Ph-Hz \_\_\_\_\_ 240/3/60

Control Volts \_\_\_\_\_ 24.0

Steps \_\_\_\_\_ 2

Heater Amps \_\_\_\_\_ 23.09

Circuit Breakers \_\_\_\_\_ SEE INSTALLER LABEL

Control Wiring \_\_\_\_\_

Power Wiring \_\_\_\_\_

Field Wiring \_\_\_\_\_