W4Y — 1005A

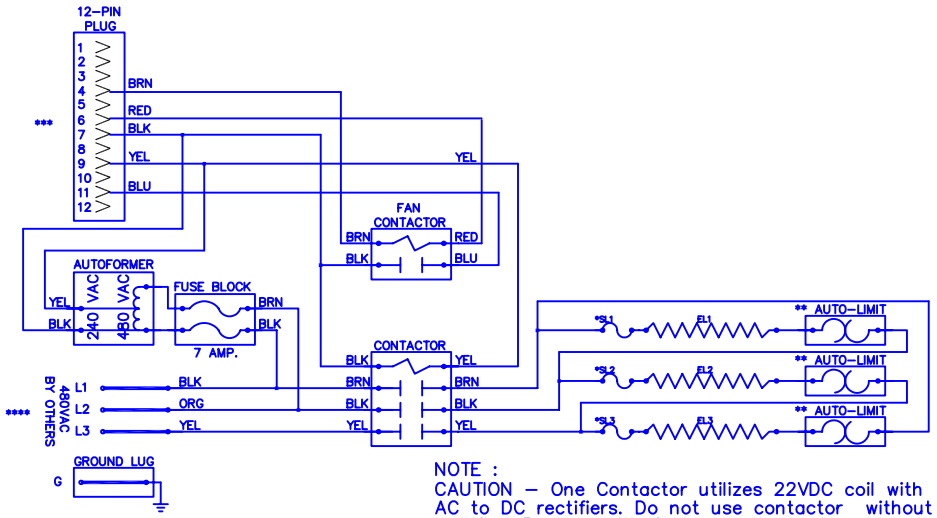

NOTE :
CAUTION – One Contactor utilizes 22VDC coil with AC to DC rectifiers. Do not use contactor without rectifier. Replace with factory authorized parts only.
–Contactor must always utilize AC–DC Rectifier with Time Delay as shown.
*Replace service loops with SL075A
** Replace Auto–Reset with Therm–O–Disc type 60TX01–F165X.
*** 24VAC, Class 2 power source must not exceed 26.4VAC under any primary input voltage condition per UL/NEC.
**** Power supply wiring per NEC & Local Codes. Suitable for at least 75°C.
Use copper conductor wiring only.

Model	W4Y–1005A
Serial #	
Tag –	
Kilowatts	10.0
Volts–Ph–Hz	480/3/⏚/60
Control Volts	24.0
Steps	1
Heater Amps	12.05

Control Wiring _ _ _ _ _ _ _ _
Power Wiring _____
Field Wiring _____

W4Y1005A

Rev. by : M. REEVES
Date : 11/30/16

WARREN TECHNOLOGY

W4Y — 1005A

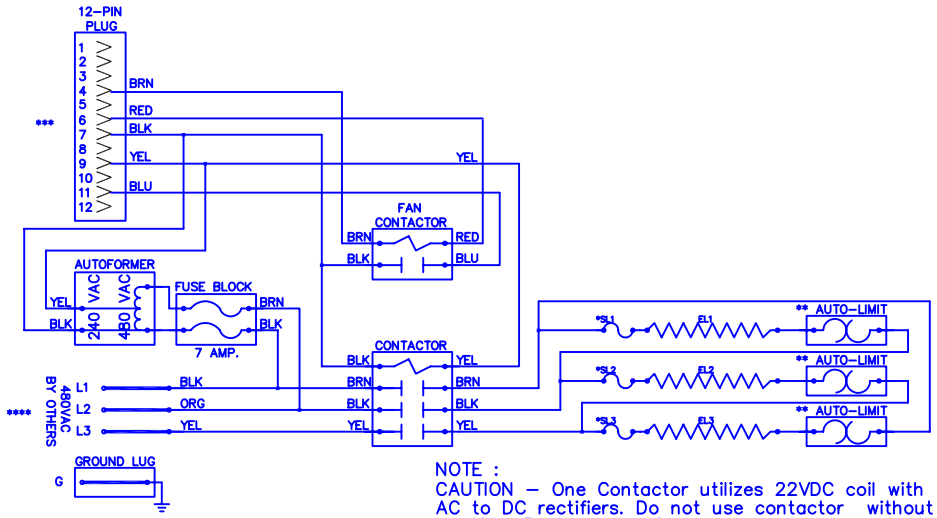

NOTE :
CAUTION – One Contactor utilizes 22VDC coil with AC to DC rectifiers. Do not use contactor without rectifier. Replace with factory authorized parts only.
–Contactor must always utilize AC–DC Rectifier with Time Delay as shown.
*Replace service loops with SL075A
** Replace Auto–Reset with Therm–O–Disc type 60TX01–F165X.
*** 24VAC, Class 2 power source must not exceed 26.4VAC under any primary input voltage condition per UL/NEC.
**** Power supply wiring per NEC & Local Codes. Suitable for at least 75°C.
Use copper conductor wiring only.

Model	W4Y–1005A
Serial #	
Tag –	
Kilowatts	10.0
Volts–Ph–Hz	480/3/⏚/60
Control Volts	24.0
Steps	1
Heater Amps	12.05

Control Wiring _ _ _ _ _ _ _ _
Power Wiring _____
Field Wiring _____

W4Y1005A

Rev. by : M. REEVES
Date : 11/30/16

WARREN TECHNOLOGY