


WEM

0402

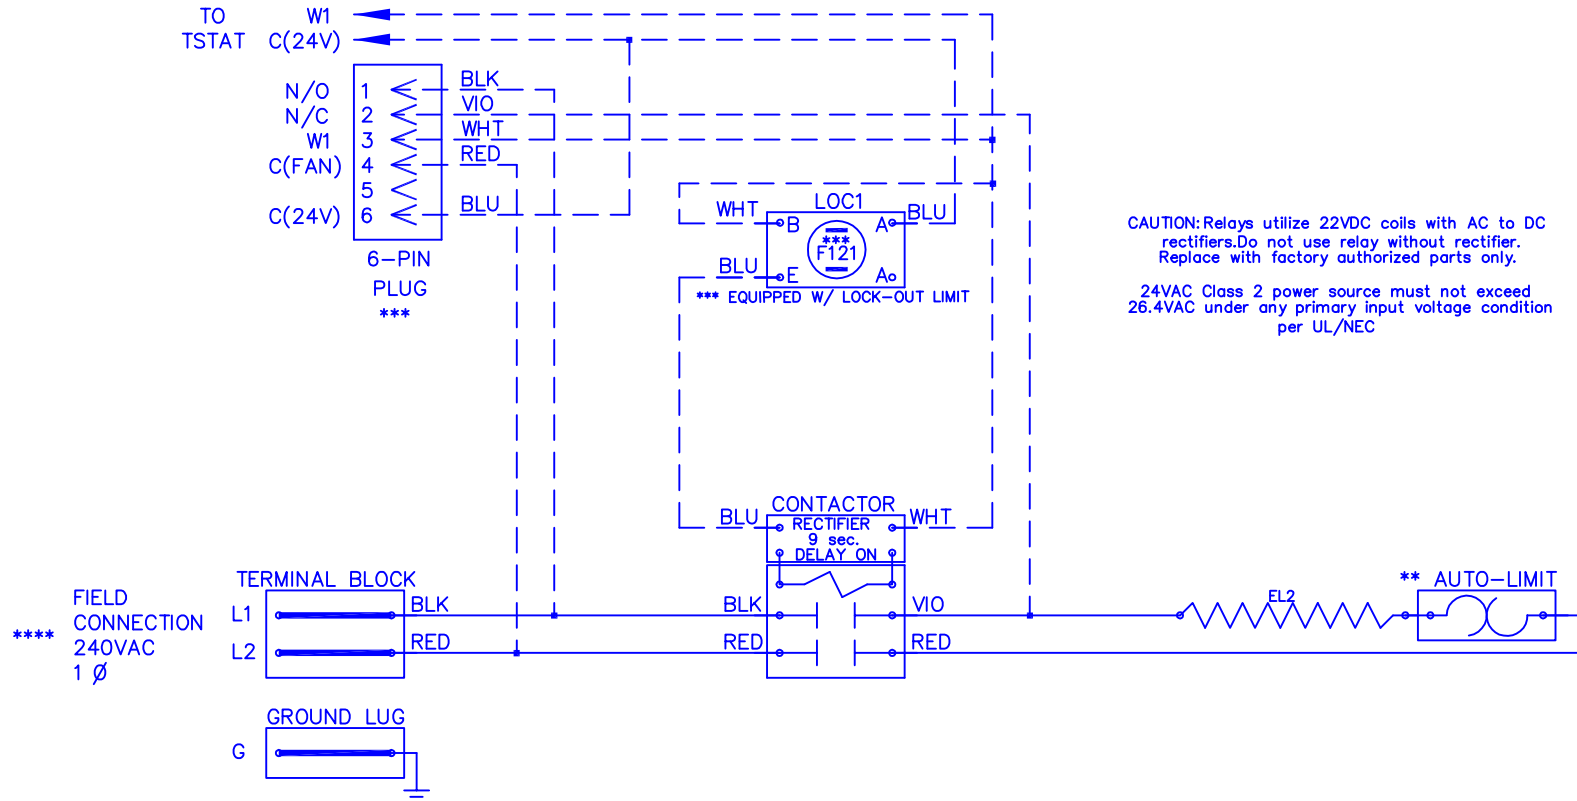

CAUTION: Relays utilize 22VDC coils with AC to DC rectifiers. Do not use relay without rectifier. Replace with factory authorized parts only.

24VAC Class 2 power source must not exceed 26.4VAC under any primary input voltage condition per UL/NEC

**** FIELD CONNECTION 240VAC 1 Ø

Model	_____ WEM-0402 _____
Serial #	_____
Tag -	_____
Kilowatts	_____ 3.84 _____
Volts-Ph-Hz	_____ 240/1/60 _____
Control Volts	_____ 24.0 _____
Steps	_____ 1 _____
Heater Amps	_____ 16.0 _____

NOTE :

CAUTION - Contactors utilize 22-28VDC coils with AC to DC rectifiers. Do not use contactor without rectifier. Replace with factory authorized parts only.

-Contactor must always utilize AC-DC Rectifier with Time Delay as shown.

** Replace Auto-Reset with Therm-O-Disc type 60TX11-L165.

*** Replace Lock-Out Limit with 36TXV12 - 121° C To Reset Lock-Out Limit, Cycle Power To The Heater With Either The Circuit Breaker Or The Thermostat.

**** 24VAC, Class 2 power source must not exceed 26.4VAC under any primary input voltage condition per UL/NEC.

***** Power supply wiring per NEC & Local Codes. Suitable for at least 75°C. Use copper conductor wiring only.

Control Wiring - - - - -

Power Wiring _____

Field Wiring _____

WEM0402

Rev. by : M. REEVES
Date : 02/10/20

WARREN TECHNOLOGY