


WEM

0402B

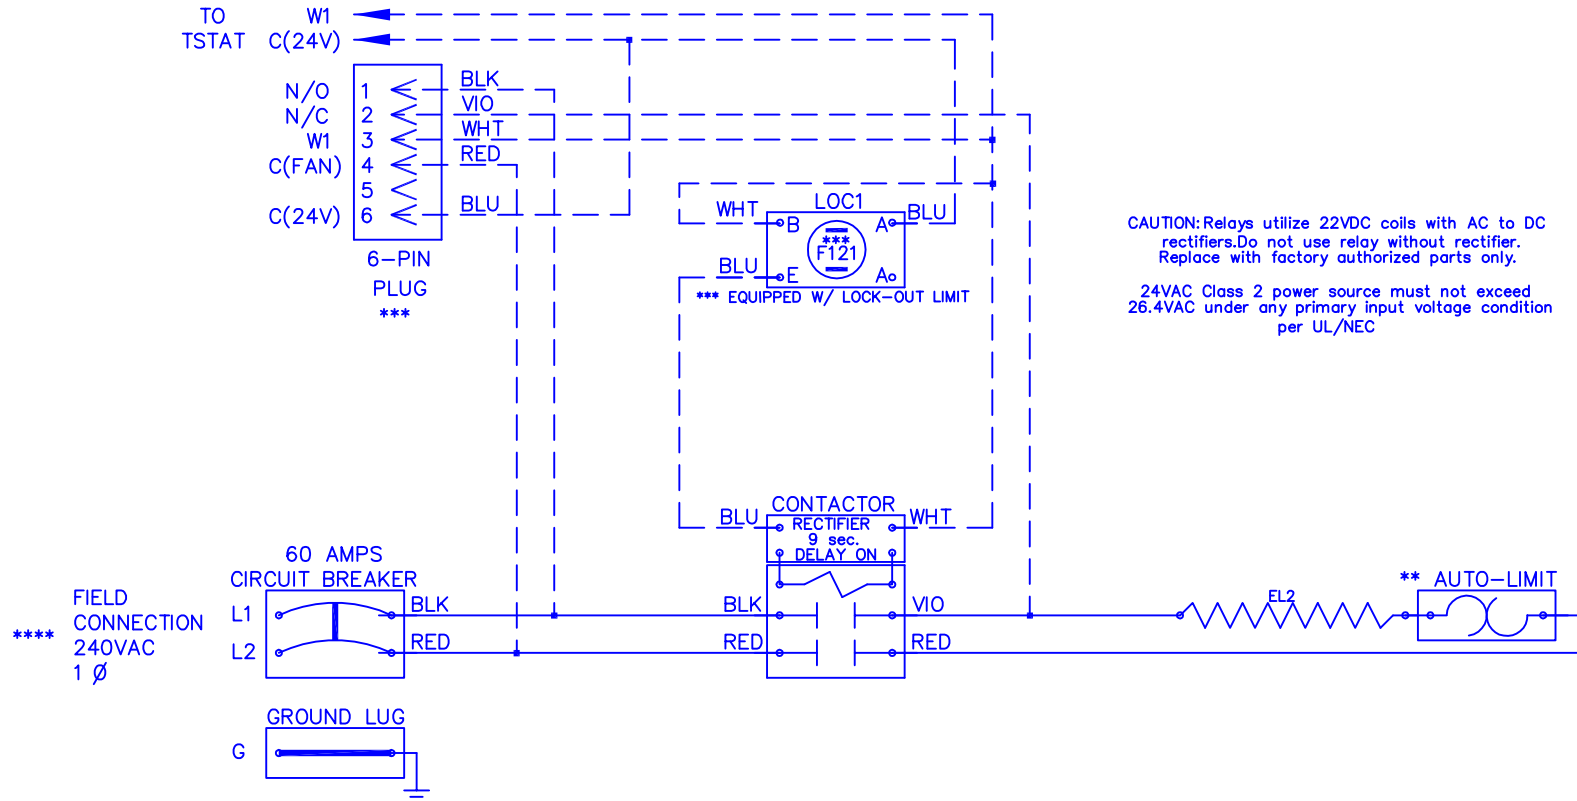

CAUTION: Relays utilize 22VDC coils with AC to DC rectifiers. Do not use relay without rectifier. Replace with factory authorized parts only.

24VAC Class 2 power source must not exceed 26.4VAC under any primary input voltage condition per UL/NEC

\*\*\*\* FIELD CONNECTION 240VAC 1 Ø

NOTE :  
 CAUTION - Contactors utilize 22-28VDC coils with AC to DC rectifiers. Do not use contactor without rectifier. Replace with factory authorized parts only.  
 -Contactor must always utilize AC-DC Rectifier with Time Delay as shown.

\*\* Replace Auto-Reset with Therm-O-Disc type 60TX11-L165.

\*\*\* Replace Lock-Out Limit with 36TXV12 - 121°C To Reset Lock-Out Limit, Cycle Power To The Heater With Either The Circuit Breaker Or The Thermostat.

\*\*\*\* 24VAC, Class 2 power source must not exceed 26.4VAC under any primary input voltage condition per UL/NEC.

\*\*\*\*\* Power supply wiring per NEC & Local Codes. Suitable for at least 75°C. Use copper conductor wiring only.

Control Wiring -----  
 Power Wiring \_\_\_\_\_  
 Field Wiring \_\_\_\_\_

Model	_____
Serial #	_____
Tag -	_____
Kilowatts	_____
Volts-Ph-Hz	_____
Control Volts	_____
Steps	_____
Heater Amps	_____
Circuit Breaker	_____

WEM0402B

Rev. by : D. VEGA  
 Date : 08/12/20

WARREN TECHNOLOGY