


WEM

0802B

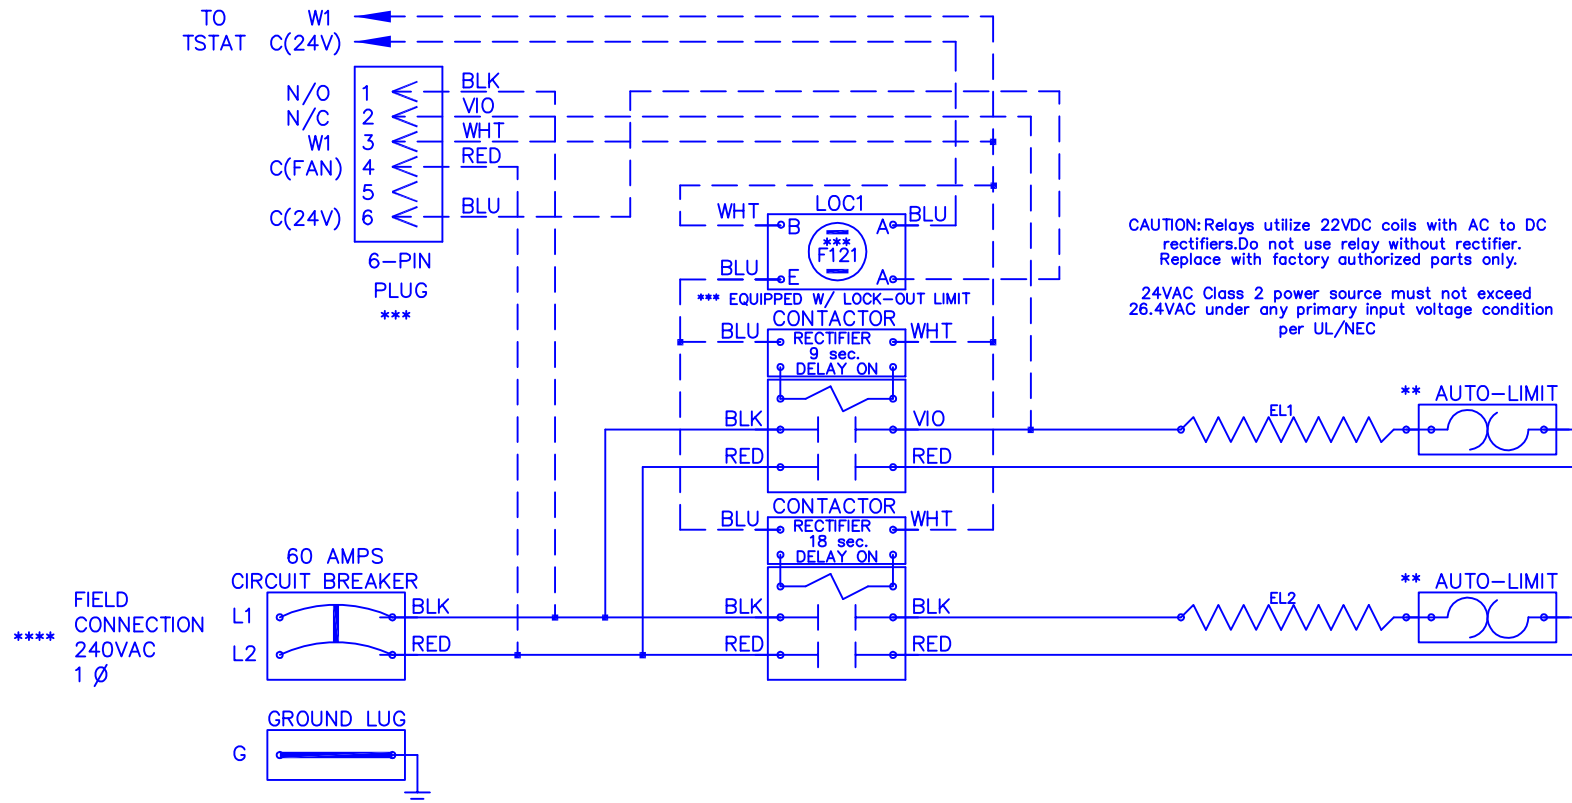

CAUTION: Relays utilize 22VDC coils with AC to DC rectifiers. Do not use relay without rectifier. Replace with factory authorized parts only.

24VAC Class 2 power source must not exceed 26.4VAC under any primary input voltage condition per UL/NEC

**** FIELD CONNECTION 240VAC 1 Ø

NOTE :

CAUTION - Contactors utilize 22-28VDC coils with AC to DC rectifiers. Do not use contactor without rectifier. Replace with factory authorized parts only.

-Contactor must always utilize AC-DC Rectifier with Time Delay as shown.

** Replace Auto-Reset with Therm-O-Disc type 60TX11-L165.

*** Replace Lock-Out Limit with 36TXV12 - 121° C To Reset Lock-Out Limit, Cycle Power To The Heater With Either The Circuit Breaker Or The Thermostat.

**** 24VAC, Class 2 power source must not exceed 26.4VAC under any primary input voltage condition per UL/NEC.

***** Power supply wiring per NEC & Local Codes. Suitable for at least 75°C. Use copper conductor wiring only.

Control Wiring -----
 Power Wiring _____
 Field Wiring _____

Model	WEM-0802B
Serial #	_____
Tag -	_____
Kilowatts	7.68
Volts-Ph-Hz	240/1/60
Control Volts	24.0
Steps	1
Heater Amps	32.0
Circuit Breaker	60

WEM0802B

Rev. by : M. REEVES
 Date : 02/10/20

WARREN TECHNOLOGY